

NH Public Utilities Commission

REC Aggregator Portal

New Users [CLICK HERE](#) to setup your account for this form. Creating an account enables you to partially complete the form and return later to finish it or to make changes after the form is submitted. Be sure to create your account **BEFORE** entering information into the form, or the information will be lost.

Existing Users [CLICK HERE](#)

Basic Information

Who is submitting this request?

Aggregator

Aggregator Batch Number

KE061416

Are you registered in NH

- Yes
- No

Aggregator name

Knollwood Energy

NH Reg #

Aggregator Email

karenton@knollwoodenergy.com

Other Aggregator name

Other aggregator email address

Facility Name

Facility Owner Name

Jim Snyder

Facility Owner email

saltcreek@aol.com

Owner Phone

603-783-9226

Facility Address

115 Asby Road

Facility Town/City

Canterbury

Facility State

NH

Facility Zip

03224

Is the facility address the same as the owner's mailing address

Yes

No

Mailing Address

Mailing Town/City

Mailing State

Mailing Zip

Primary Contact

Karen Tenneson

Primary Contact

Facility Primary Contact

karenton@knollwoodenergy.com

Other Email Address

Facility Information

Class

Utility

Other Utility Name

To obtain a GIS ID contact:

James Webb

408 517 2174

jwebb@apx.com

GIS ID (include "NON")

Date of Initial Operation

Facility Operator Name, if applicable

Panel Make #1

Panel Model

Panel Quantity

Panel Rated Output

Other panel make

Other panel model

More Panel types?

- No
 Yes

Panel Make #2

Panel Model

Panel Quantity

Panel Rated Output

More Panel types?

- No
 Yes

Panel Make #3

Panel Model

Panel Quantity

Panel Rated Output

System capacity based on panels

Inverter Make

Other inverter make

Inverter Quantity

1

Add'l Inverter Quantity

NA

Additional Inverter Make

None

Rated Output - Primary Inverter

5300

Rated Output - Additional Inverter

System capacity based on single inverter make

5300

System capacity based on two inverter types

System capacity in kW as stated on the interconnection agreement

5.880

Revenue Grade Meter Make

Revenue Grade GIS Approved Meter

OTHER

Other revenue-grade GIS-approved meter

ABB

Was this facility installed directly by the customer (no electrician involved)?

- Yes
- No

Electrician Name & Number

Other

Other Electrician Name & Number

Loyalty Electric #13370M

Installation Company

Other Installation Company Name

Other Inst. Company Address

Other Inst. Company City

Other Inst. Company State

Other Inst. Company Zip

Equipment Vendor Company Name

Independent Monitor Name & Company

Other Monitor Name and Company

Is the installer also the equipment supplier?

- Yes
 No

Equipment Vendor

Please attach your completed interconnection agreement including Exhibit B.

The project described in this application will meet the metering requirements of PUC 2506 including:

Electricity generation in megawatt hours shall be reported to the GIS quarterly with a statement that the submission is accurate by the owner of the source, the independent monitor or a designated representative.

A revenue quality meter (meeting ANSI C-12.1-2008 for installations up to and including 10 kW, or ANSI C12.16 or better for installations greater than 10kW up to 1 mW) is used to measure the electricity generated.

The facility owner has certified to the independent monitor that the meter operates according to manufacturing standards.

The meter shall be maintained according to the manufacturer's recommendations.

The project is installed and operating in conformance with applicable building codes.

A copy of the facility's interconnection agreement is attached.

Please attach additional document here


https://fs30.formsite.com/jan1947/files/f-5-168-6998171_JVK2uSib_Jim_Snyder_contract_part_3_-_sig

Please attach additional document here

https://fs30.formsite.com/jan1947/files/f-5-173-6998171_qCgEcevV_N2700SnyderPV-ProcessedAppli

Aggregator statement of accuracy

Sign your name using a mouse or, if you are using a touch-screen device, a stylus or other pointer.



Print Name

Karen Tonnesen

Date Signed

06/14/2016

PUBLIC SERVICE COMPANY OF NEW HAMPSHIRE
INTERCONNECTION STANDARDS FOR INVERTERS
SIZED UP TO 100 KVA (Continued)

Exhibit B - Certificate of Completion for Simplified Process Interconnections

Installation Information:

Check if owner-installed

Customer or Company Name (print): Jim Snyder
Contact Person, if Company: _____
Mailing Address: 125 Asby Road
City: Canterbury State: NH Zip Code: 03224
Telephone (Daytime): 783 9226 (Evening): _____
Facsimile Number: _____ E-Mail Address: saltcreek@aol.com

Address of Facility (if different from above): 115 Asby Road
City: Canterbury State: NH Zip Code: 03224

Generation Vendor: _____ Contact Person: _____

I hereby certify that the system hardware is in compliance with Puc 900.

Vendor Signature: _____

Date: _____

Electrical Contractor's Name (if appropriate): Loyalty Electric
Mailing Address: 88 S. Wilson Street
City: Manchester State: NH Zip Code: 03103
Telephone (Daytime): 848 0045 (Evening): _____
Facsimile Number: _____ E-Mail Address: sheppardjedd@gmail.com
License number: 13370M

Date of approval to install Facility granted by the Company: 5/20/13 Installation Date: 5/11/13


Application ID number: #N2700

Inspection:

The system has been installed and inspected in compliance with the local Building/Electrical Code of

Canterbury

(City/County)


Signed (Local Electrical Wiring Inspector, or attach signed electrical inspection): 

Name (printed): Jim Snyder

Date: 5/21/13

Customer Certification:

I hereby certify that, to the best of my knowledge, all the information contained in this Interconnection Notice is true and correct. This system has been installed and shall be operated in compliance with applicable electrical standards. Also, the initial start up test required by Puc 905.04 has been successfully completed.

Customer Signature:  Date: 7/15/13

**PUBLIC SERVICE COMPANY OF NEW HAMPSHIRE
INTERCONNECTION STANDARDS FOR INVERTERS
SIZED UP TO 100 KVA (Continued)**

As a condition of interconnection you are required to send/fax a copy of this form to :

Company: Public Service Company of New Hampshire
Name: Supplemental Energy Sources Department
Mail 1: 780 North Commercial Street
Mail 2: P. O. Box 330
City, State ZIP: Manchester, NH 03105-0330
Fax No.: (603) 634-2449

New Hampshire PUC REC Certification Application Owner Statements

The information provided on this application for New Hampshire Renewable Energy Certificate eligibility is accurate to the best of my knowledge and I authorize Knollwood Energy to act on my behalf in filing said application.

The project described in this application will meet the metering requirements of PUC 2506 including:

Electricity generation in megawatt hours shall be reported to the GIS quarterly with a statement that the submission is accurate by the owner of the source, the independent monitor, or a designated representative.

A revenue quality meter is used to measure the electricity generated.

The facility owner has certified to the independent monitor that the meter operates according to manufacturing standards.

The meter shall be maintained according to the manufacturer's recommendations.

The project is installed and operating in conformance with applicable building codes.

A copy of the facility's interconnection agreement is attached.

Jim Snyder

Printed Name of signature owner


Jim Snyder (Jun 3, 2016)

Signature of system owner

RECEIVED
MAY 20 2013

PUBLIC SERVICE COMPANY OF NEW HAMPSHIRE
INTERCONNECTION STANDARDS FOR INVERTERS
SIZED UP TO 100 KVA

BY:

Simplified Process Interconnection Application and Service Agreement

Date Prepared: 5/20/13

Contact Information:

Legal Name and Address of Interconnecting Customer (or, Company name, if appropriate)

Customer or Company Name (print): James Snyder

Contact Person, if Company: _____

Mailing Address: 125 Asby Road

City: Canterbury State: NH Zip Code: 03224

Telephone (Daytime): 783 9226 (Evening): 783 9226

Facsimile Number: _____ E-Mail Address: saltcreek@aol.com

Alternative Contact Information (e.g., System installation contractor or coordinating company, if appropriate):

Name: _____

Mailing Address: _____

City: _____ State: _____ Zip Code: _____

Telephone (Daytime): _____ (Evening): _____

Facsimile Number: _____ E-Mail Address: _____

Electrical Contractor Contact Information (if appropriate):

Name: Ed Sheppard

Mailing Address: 88 S. Wilson Street

City: Manchester State: NH Zip Code: 03103

Telephone (Daytime): 848 0045 (Evening): 848 0045

Facsimile Number: _____ E-Mail Address: sheppardjedd.e@gmail.com

Facility Site Information:

✓ Facility (Site) Address: 115 Asby Road

✓ City: Canterbury State: NH Zip Code: 03224

Electric

Service Company: PSNH Account Number: _____ Meter Number: _____

Non-Default' Service Customers Only:

not yet connected

Competitive Electric

Energy Supply Company: _____ Account Number: _____

(Customer's with a Competitive Energy Supply Company should verify the Terms & Conditions of their contract with their Energy Supply Company.)

Facility Machine Information:

Generator/

✓ Inverter Manufacturer: Solecristia Model Name & Number: PVI 5300 ✓ Quantity: 1


✓ Nameplate Rating: 5,300 (kW) _____ (kVA) _____ (AC Volts) 240 Phase: Single Three

System Design Capacity: _____ (kW) _____ (kVA) Battery Backup: Yes No

Net Metering: If Renewably Fueled, will the account be Net Metered? Yes No

Prime Mover: Photovoltaic Reciprocating Engine Fuel Cell Turbine Other _____

✓ Energy Source: Solar Wind Hydro Diesel Natural Gas Fuel Oil Other _____

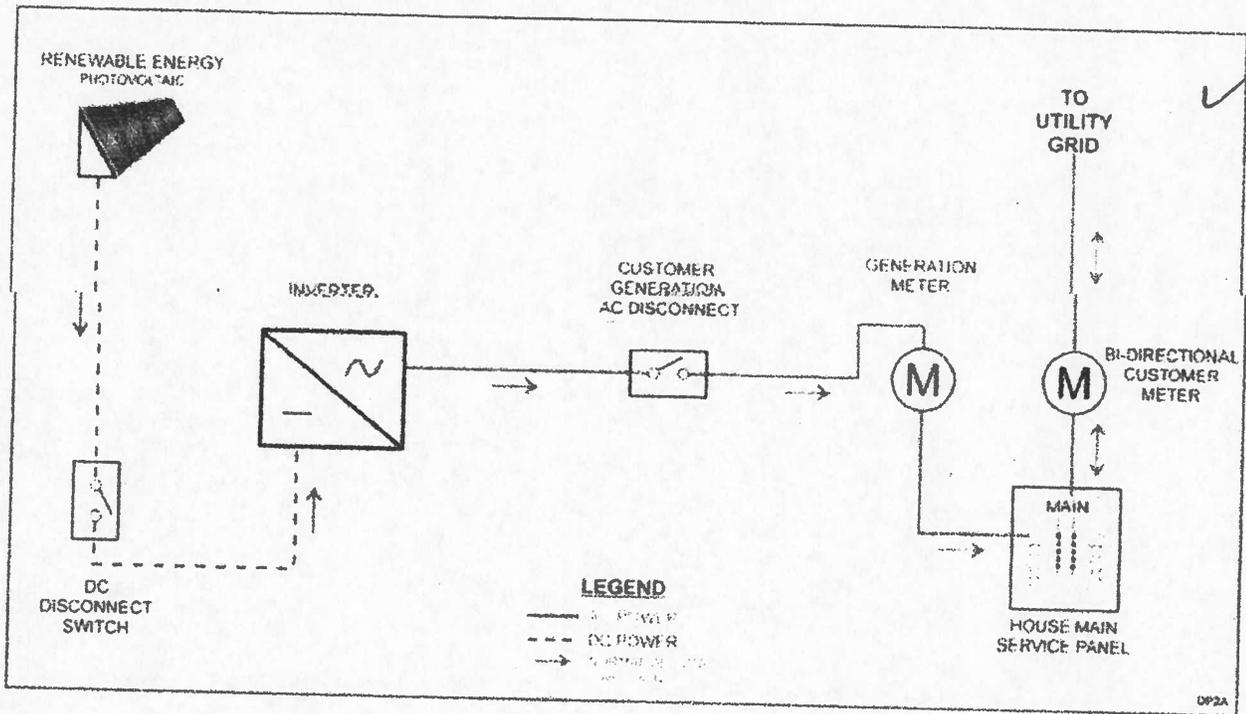

Notes

1. 24 modules, SolarWorld 245 Watt Solar Panel, SunModule SW245 Poly, V2.5 Frame
2. Solectria PVI 5300W Grid-tie Inverter
3. AC and DC disconnect switches are integrated in one device on the inverter case ✓
4. Main service panel is backed by inverter through a 30 amp breaker

PUBLIC SERVICE COMPANY OF NEW HAMPSHIRE
INTERCONNECTION STANDARDS FOR INVERTERS
SIZED UP TO 100 KVA

Terms and Conditions for Simplified Process Interconnections

Company waives inspection/Witness Test: Yes No

Date of inspection/Witness Test: _____

1. **Construction of the Facility.** The Interconnecting Customer may proceed to construct the Facility in compliance with the specifications of its Application once the Approval to Install the Facility has been signed by the Company.
2. **Interconnection and operation.** The Interconnecting Customer may operate Facility and interconnect with the Company's system once the all of the following has occurred:
 - 2.1. **Municipal Inspection.** Upon completing construction, the Interconnecting Customer will cause the Facility to be inspected or otherwise certified by the local electrical wiring inspector with jurisdiction.
 - 2.2. **Certificate of Completion.** The Interconnecting Customer returns the Certificate of Completion to the Agreement to the Company at address noted.
 - 2.3. **Company has completed or waived the right to inspection.**
3. **Company Right of Inspection.** The Company will make every attempt within ten (10) business days after receipt of the Certificate of Completion, and upon reasonable notice and at a mutually convenient time, conduct an inspection of the Facility to ensure that all equipment has been appropriately installed and that all electrical connections have been made in accordance with the Interconnection Standard. The Company has the right to disconnect the Facility in the event of improper installation or failure to return Certificate of Completion. All projects larger than 10 kVA will be witness tested, unless waived by the Company.
4. **Safe Operations and Maintenance.** The Interconnecting Customer shall be fully responsible to operate, maintain, and repair the Facility.
5. **Disconnection.** The Company may temporarily disconnect the Facility to facilitate planned or emergency Company work.
6. **Metering and Billing.** All renewable Facilities approved under this Agreement that qualify for net metering, as approved by the Commission from time to time, and the following is necessary to implement the net metering provisions:
 - 6.1. **Interconnecting Customer Provides:** The Interconnecting Customer shall furnish and install, if not already in place, the necessary meter socket and wiring in accordance with accepted electrical standards. In some cases the Interconnecting Customer may be required to install a separate telephone line.
 - 6.2. **Company Installs Meter.** The Company will make every attempt to furnish and install a meter capable of net metering within ten (10) business days after receipt of the Certificate of Completion if inspection is waived, or within 10 business days after the inspection is completed, if such meter is not already in place.
7. **Indemnification.** Interconnecting Customer and Company shall each indemnify, defend and hold the other, its directors, officers, employees and agents (including, but not limited to, Affiliates and contractors and their employees), harmless from and against all liabilities, damages, losses, penalties, claims, demands, suits and proceedings of any nature whatsoever for personal injury (including death) or property damages to unaffiliated third parties that arise out of, or are in any manner connected with, the performance of this Agreement by that party, except to the extent that such injury or damages to unaffiliated third parties may be attributable to the negligence or willful misconduct of the party seeking indemnification.
8. **Limitation of Liability.** Each party's liability to the other party for any loss, cost, claim, injury, liability, or expense, including reasonable attorney's fees, relating to or arising from any act or omission in its performance of this Agreement, shall be limited to the amount of direct damage actually incurred. In no event shall either party be liable to the other party for any indirect, incidental, special, consequential, or punitive damages of any kind whatsoever.
9. **Termination.** This Agreement may be terminated under the following conditions:
 - 9.1. **By Mutual Agreement.** The Parties agree in writing to terminate the Agreement.
 - 9.2. **By Interconnecting Customer.** The Interconnecting Customer may terminate this Agreement by providing written notice to Company.
 - 9.3. **By Company.** The Company may terminate this Agreement (1) if the Facility fails to operate for any consecutive 12 month period, or (2) in the event that the Facility impairs or, in the good faith judgment of the Company, may imminently impair the operation of the electric distribution system or service to other customers or materially impairs the local circuit and the Interconnecting Customer does not cure the impairment.
10. **Assignment/Transfer of Ownership of the Facility.** This Agreement shall survive the transfer of ownership of the Facility to a new owner when the new owner agrees in writing to comply with the terms of this Agreement and so notifies the Company.
11. **Interconnection Standard.** These Terms and Conditions are pursuant to the Company's "Interconnection Standards for Inverters Sized Up to 100 kVA" for the Interconnection of Customer-Owned Generating Facilities, as approved by the Commission and as the same may be amended from time to time ("Interconnection Standard"). All defined terms set forth in these Terms and Conditions are as defined in the Interconnection Standard (see Company's website for the complete document).

PUBLIC SERVICE COMPANY OF NEW HAMPSHIRE
INTERCONNECTION STANDARDS FOR INVERTERS
SIZED UP TO 100 KVA
Simplified Process Interconnection Application and Service Agreement

Inverter-based Generating Facilities:

✓ UL 1741 / IEEE 1547.1 Compliant (Refer To Part Puc 906 Compliance Path For Inverter Units, Part Puc 906.01 Inverter Requirements)
Yes No

The standard UL 1741.1 dated May, 2007 or later, "Inverters, Converters, and Controllers for Use in Independent Power Systems," addresses the electrical interconnection design of various forms of generating equipment. Many manufacturers choose to submit their equipment to a Nationally Recognized Testing Laboratory (NRTL) that verifies compliance with UL 1741.1. This term "Listed" is then marked on the equipment and supporting documentation. *Please include, any documentation provided by the inverter manufacturer describing the inverter's UL 1741/IEEE 1547.1 listing.*

External Manual Disconnect Switch:

An External Manual Disconnect Switch shall be installed in accordance with 'Part Puc 905 Technical Requirements For Interconnections For Facilities, Puc 905.01 Requirements For Disconnect Switches and 905.02 Disconnect Switch.'

Yes No

Location of External Manual Disconnect Switch: _____

Project Estimated Install Date: 5/11/13 Project Estimated In-Service Date: 6/11/13

Interconnecting Customer Signature:

I hereby certify that, to the best of my knowledge, all of the information provided in this application is true and I agree to the Terms and Conditions for Simplified Process Interconnections attached hereto:

Customer Signature: James Snyder Title: Owner Date: 5/20/13
Please include, a one-line and/or three-line drawing of proposed installation

For PSNH Use Only

Approval to Install Facility:

Installation of the Facility is approved contingent upon the Terms and Conditions For Simplified Process Interconnections of this Agreement, and agreement to any system modifications, if required.

Are system modifications required? Yes No To be Determined

Company Signature: Michael Motta Title: Sr. ENGINEER Date: 5-20-13

PSNH Application Project ID#: _____

PRYFIELD 31W1 MAD P. 6361/SB5A XMR 15KVA
PH. 3 (c)
OAK HILL S/S - PTF