

Northeast Utilities

**U199 LINE (115KV) CROSSING
LOCUS MAP
AMMONOOSUC RIVER, LITTLETON, NH**

Transmission Business


DRAWN
JFH

DATE
5/2014


APPROVED

DRAWING NO.
EXHIBIT 1

THIS PLAN IS FOR REFERENCE ONLY.
NO REPRESENTATION OR WARRANTY IS
MADE AS TO LOCATION OF BOUNDARIES
OR OTHER POINTS OF REFERENCE

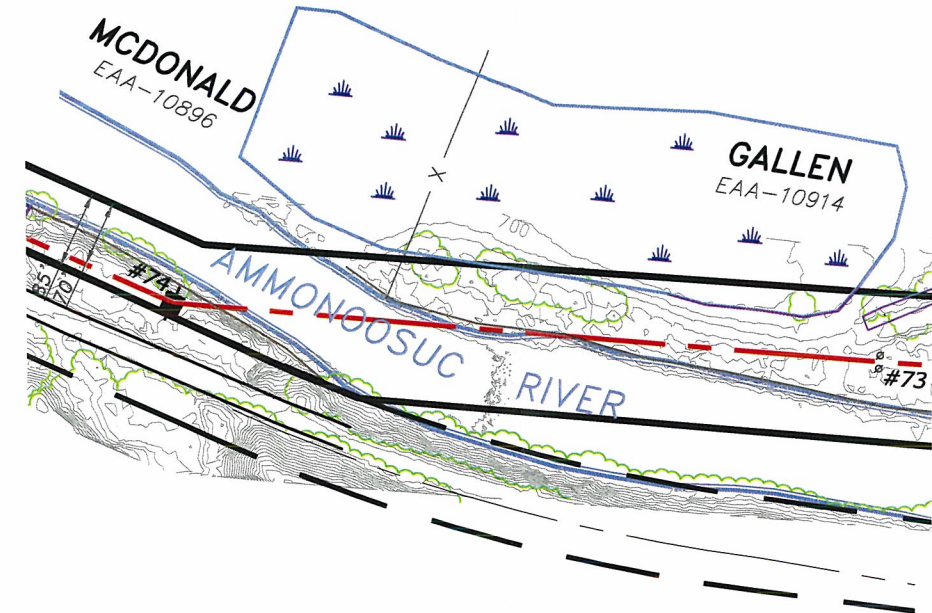

PLAN VIEW
SCALE: 1"=200'

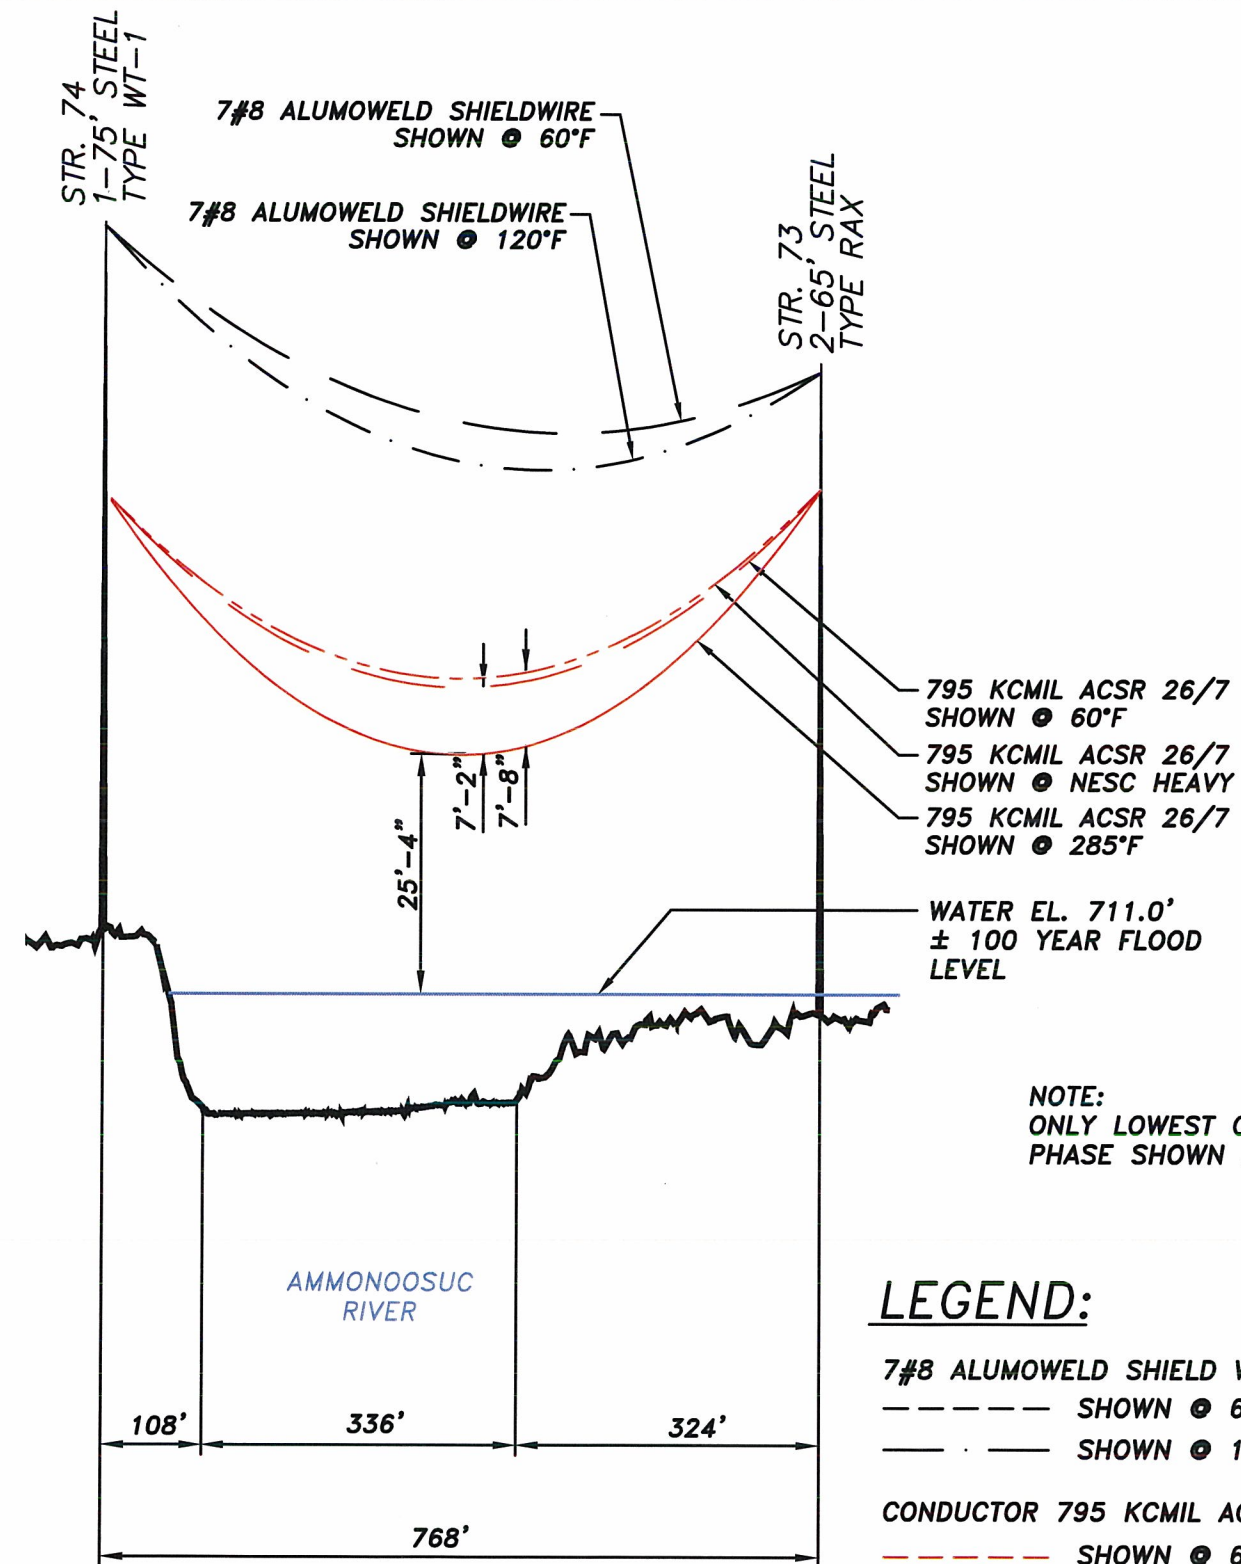

PROFILE VIEW
SCALE: 1"=200' HORIZ.
SCALE: 1"=20' VERT.

- 795 KCMIL ACSR 26/7 SHOWN @ 60°F
- 795 KCMIL ACSR 26/7 SHOWN @ NESC HEAVY
- 795 KCMIL ACSR 26/7 SHOWN @ 285°F

WATER EL. 711.0'
± 100 YEAR FLOOD LEVEL

NOTE:
ONLY LOWEST CONDUCTOR
PHASE SHOWN FOR CLARITY

LEGEND:

- 7#8 ALUMOWELD SHIELD WIRE
- SHOWN @ 60°F
- SHOWN @ 120°F
- CONDUCTOR 795 KCMIL ACSR 26/7
- SHOWN @ 60°F
- SHOWN @ NESC HEAVY
- SHOWN @ 285°F

0	100% WO# T1244A1	05/14	RRR	JFH	RPL
NO.	REVISION	DATE	DRWN	CHKD	APPR

Public Service of New Hampshire A Northeast Utilities Company	TRANSMISSION BUSINESS		#
			T
DRAWN RRR ENGINEER JFH CHECKED JFH APPROVED RPL	U199 LINE (115kV) CROSSING BETWEEN STR. 74 & STR. 73 AMMONOOSUC RIVER CROSSING LITTLETON, NEW HAMPSHIRE		
SCALE AS SHOWN	DATE 05/14	SHEET 1 OF 2	DRAWING NO. EXHIBIT 1